


## ENTRANCEWAY – ELEVATION

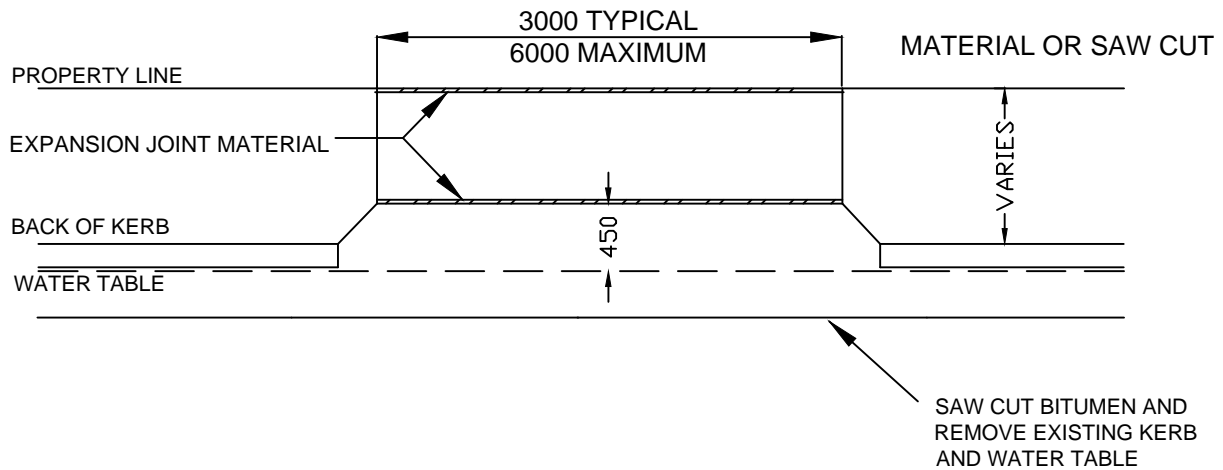

## ENTRANCEWAY – PLAN

SCALE: N.T.S.

### NOTES

1. EXPANSION JOINT TO BE 10mm THICK COMPRESSIBLE FILLER MATERIAL FOR FULL DEPTH OF PAVEMENT. TOP OF JOINT TO BE SEALED WITH A SUITABLE SILICON OR POLYURETHANE SEALANT
2. SLAB TO BE 125mm THICK (150 IN INDUSTRIAL AREAS), 25MPa CONCRETE, 60-80mm SLUMP AND SL62 MESH REINFORCING WITH 50mm COVER TO UNDERSIDE OF CONCRETE.
3. SUB-BASE TO BE 75mm OF 5mm RUBBLE FORMED AND COMPACTED TO A MINIMUM OF 95%SMDD
4. STEEL FLOAT FINISH OR MOIST HAIR BROOM ACROSS DIRECTION OF TRAVEL.
5. FOR DETAILS OF BARRIER KERB SEE DETAIL SK - 305

DRAWN		TOWN OF GAWLER STANDARD DETAILS VEHICLE CROSSOVER FOR BARRIER KERB	SCALE N.T.S.
CHECKED			DRAWING NUMBER
APPROVED			SK - 302
DATE	8 SEPTEMBER 2015		REV C